



PLAN VIEW

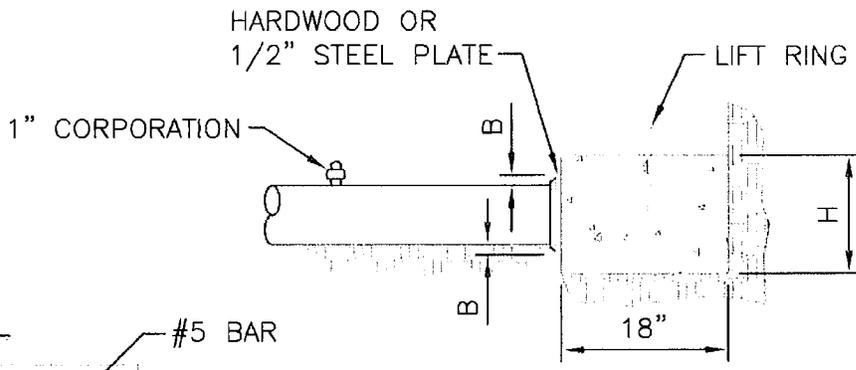

SECTION A-A

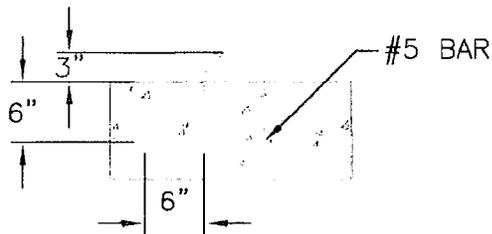

LIFT RING DETAIL

PIPE DIA.	H	B	L
6"	8"	1"	10'
8"	10"	1"	10'
12"	18"	3"	18'

NOTES:

BACKING DESIGNED FOR 4000 PSF SOIL BEARING.

END OF PIPE CAPPED OR PLUGGED.

GREASE STEEL PLATE WHERE IN CONTACT WITH CONCRETE BACKER.

PLACE CONCRETE AGAINST UNDISTURBED SOIL.

THOROUGHLY COMPACT BACKFILL BETWEEN VALVE AND END OF PIPE.

APPROVED _____

CITY ENGINEER

REVISED: 3/7/07

END OF PIPE THRUST
BLOCK DETAIL

CITY OF LANCASTER, OHIO
DEPARTMENT OF ENGINEERING

STANDARD
CONSTRUCTION DRAWING

DWG. BY: ...MAC...
CHK'D BY:

FILE NUMBER
W-15