


NOTES:

1. THE PENETRATION ON THE MAIN SEWER SHALL BE CORED FOR THE DIAMETER REQUIRED FOR THE INSERT-A-TEE (OR APPROVED EQUAL) FLEXIBLE CONNECTOR. DOES NOT APPLY TO FABRICATED OR MOLDED FITTINGS.
2. PIPE MATERIALS SHALL BE IN CONFORMANCE WITH 901.02.
3. BEGINNING OF BELL SECTION OF STUB PIPE TO BE FLUSH WITH END OF FLEXIBLE CONNECTOR.
4. STUB PIPE SHALL NOT EXTEND INTO MAIN SEWER.
5. VERTICAL RISER MAY LAY AGAINST UNDISTURBED SOIL.

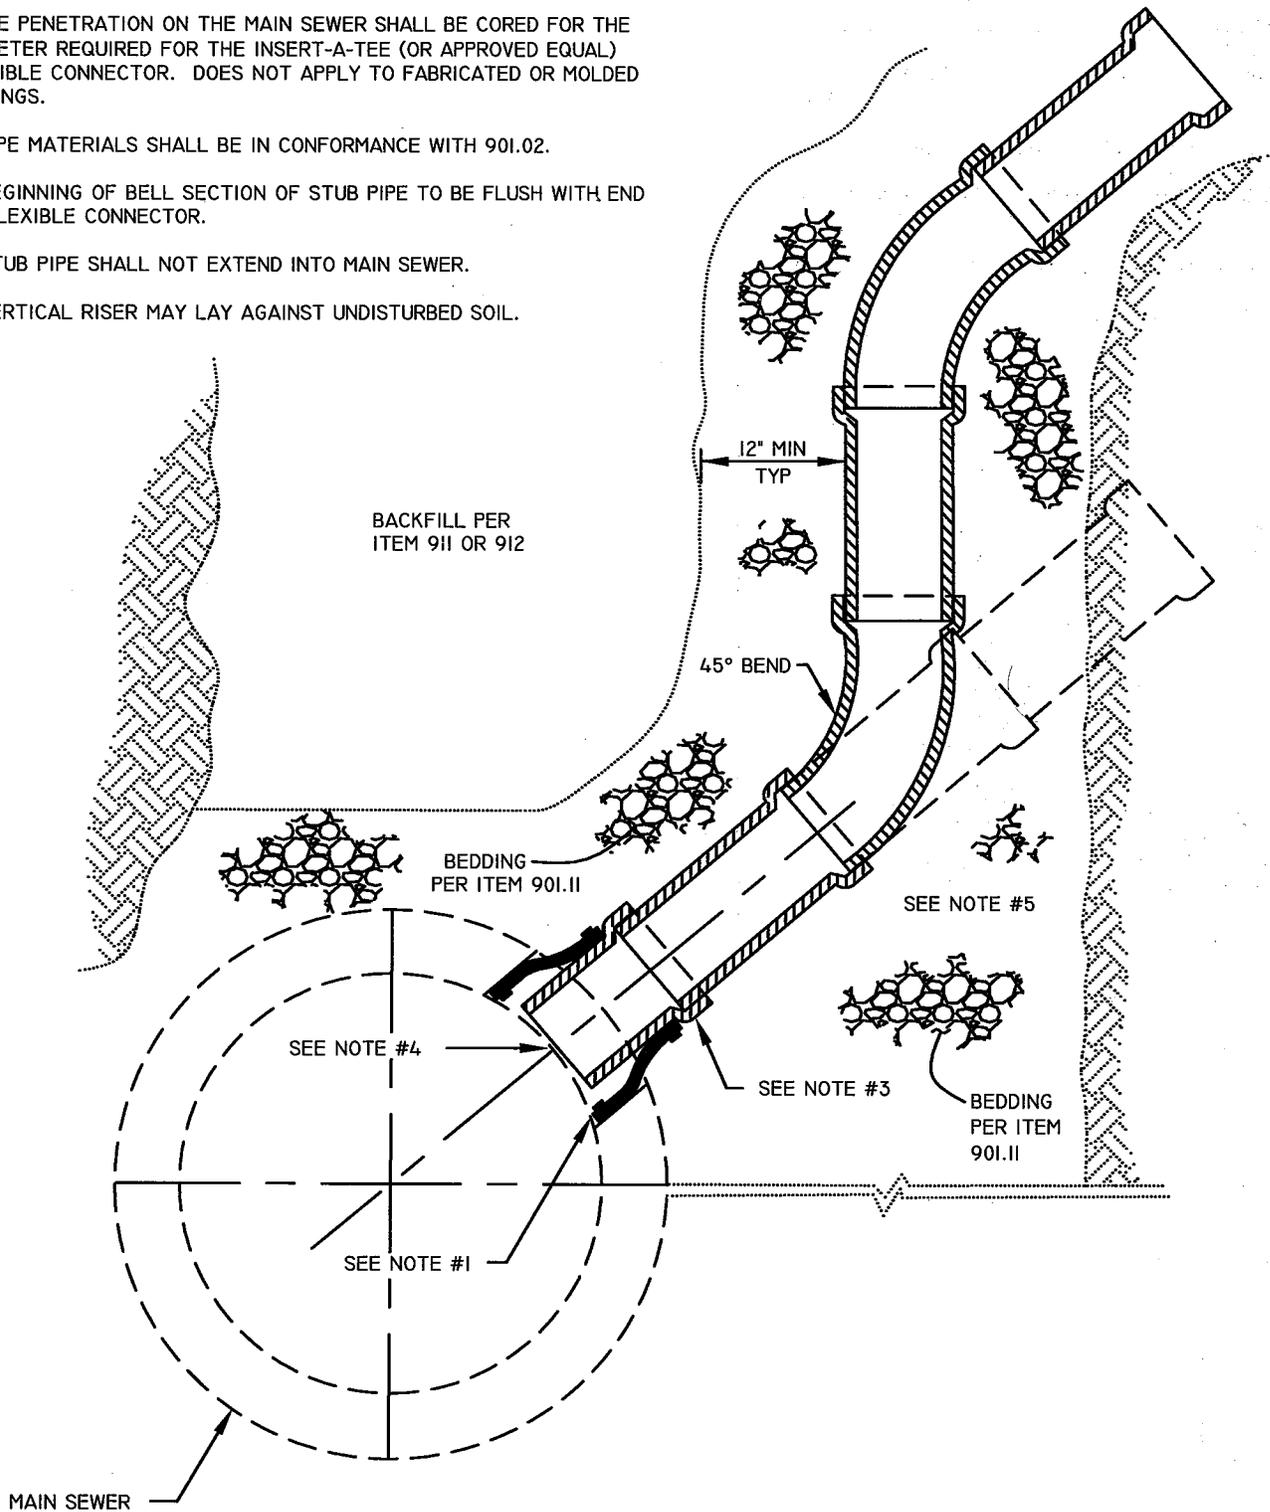

APPROVED 4-3-13
Brad Fagrell
 CITY ENGINEER
 REVISED: 26 MAR 13

TYPICAL CORED
 RISER DETAIL

CITY OF LANCASTER, OHIO
 DEPARTMENT OF ENGINEERING
 STANDARD
 CONSTRUCTION DRAWING
 DWG. BY: DDK
 CHK'D BY: M.B.NIXON
 FILE NUMBER
 S-21