



ISOMETRIC VIEW

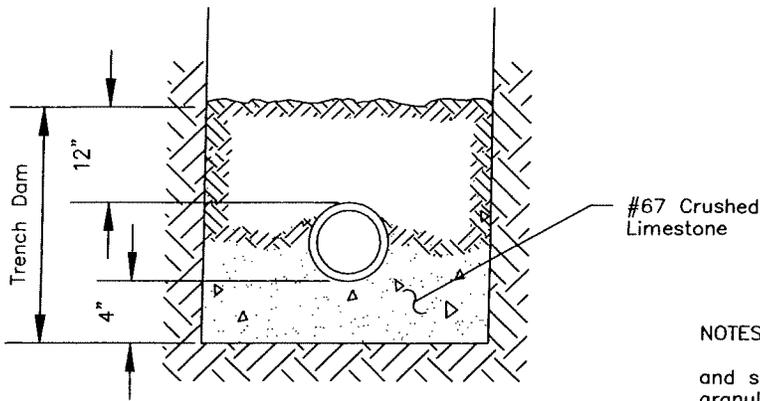

SECTION B-B

Approved Stopper until connected to house plumbing

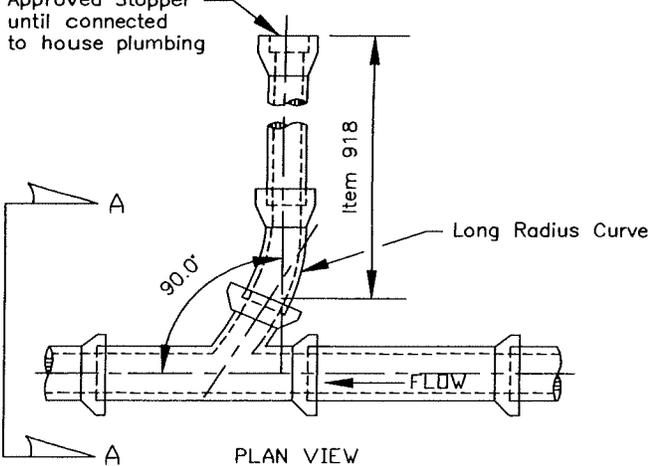


PLAN VIEW

NOTES:

Trench Dams are required as specified under 918.04 and shall be constructed to 12" over the pipe, if compacted granular material is used for backfilling, or to the height of bedding material.

Sanitary house connection services shall be connected to the existing sewer with the same material fitting or with a compatible adapter in accordance with 918.02.

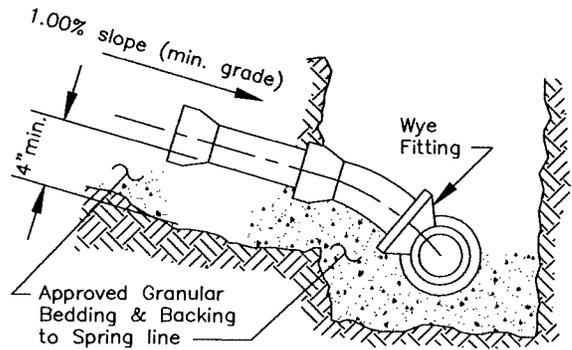

SECTION A-A

APPROVED 3-24-05

Keith Hunter
CITY ENGINEER

REVISED: 14 Feb 2005



TYPICAL SANITARY
HOUSE CONNECTION
SERVICE

CITY OF LANCASTER, OHIO
DEPARTMENT OF ENGINEERING


STANDARD
CONSTRUCTION DRAWING

DWG. BY: DDK
CHK'D BY: TJH

FILE NUMBER
S-20 SHEET
1 OF 2

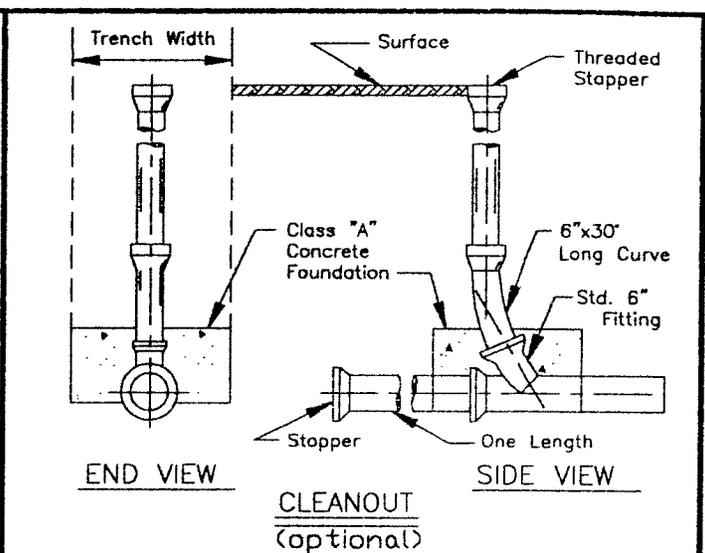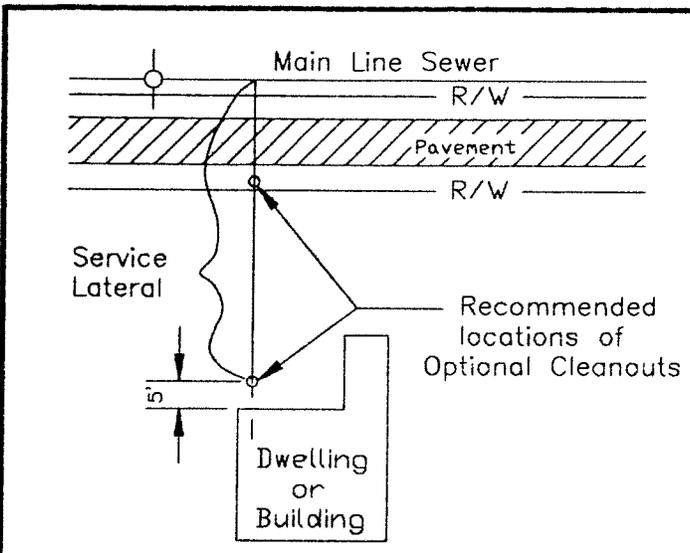

ALLOWABLE CONNECTIONS—
SANITARY HOUSE CONNECTION TO BUILDING WASTE LINE

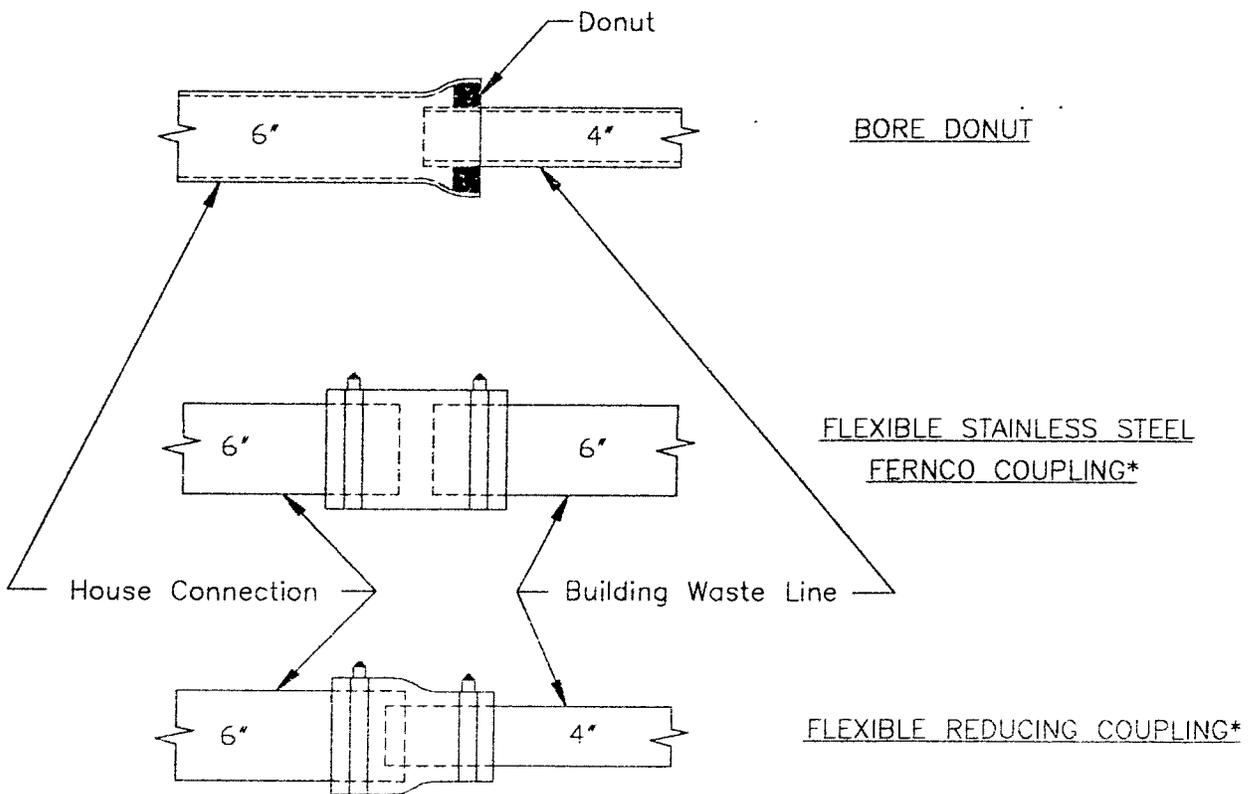

*COUPLING CLAMPS SHALL BE STAINLESS STEEL

APPROVED 10-30-00

Kent Houston
CITY ENGINEER

REVISED: 19 OCT 2000

TYPICAL SANITARY
HOUSE CONNECTION
SERVICE

CITY OF LANCASTER, OHIO
DEPARTMENT OF ENGINEERING

STANDARD
CONSTRUCTION DRAWING

DWG. BY: DDK FILE NUMBER
CHK'D BY: RM S-20 SHEET
2 OF 2