



TRENCH DAMS SHALL BE BUILT PER CMSL 901.11

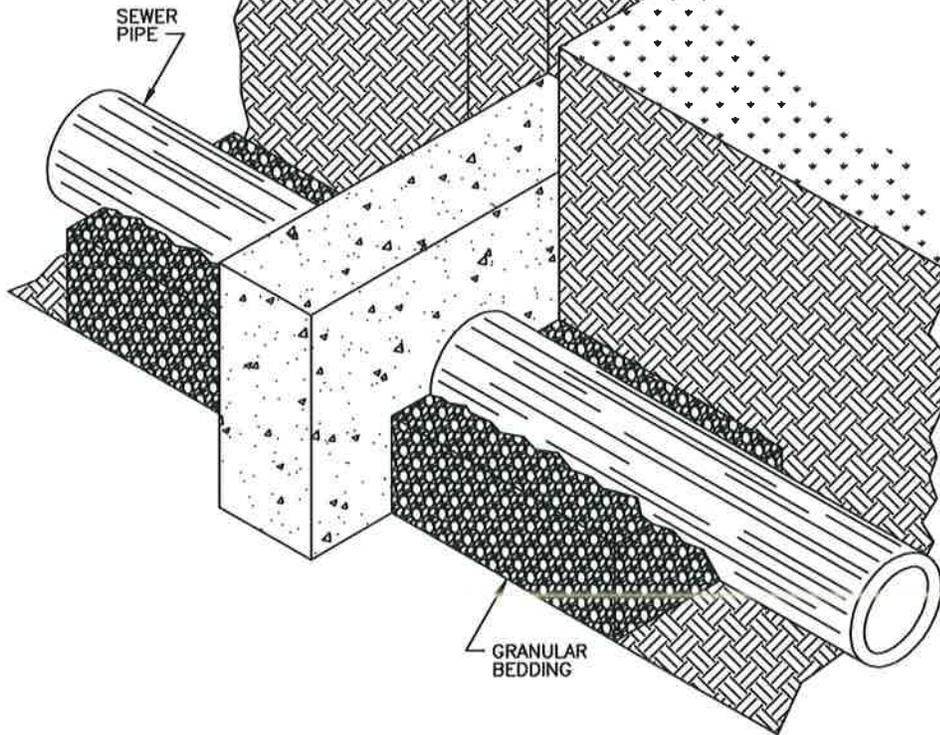

(*) 2.5', OR A LENGTH SUCH THAT THE TOP OF THE TRENCH DAM IS 5' BELOW FINISHED GRADE, WHICHEVER IS GREATER.

NOTE: NO PIPE JOINTS SHALL BE COVERED BY THE TRENCH DAM. FOR CLAY PIPE, THE TRENCH DAM SHALL RUN THE FULL LENGTH OF ONE PIPE SEGMENT, FROM JOINT TO JOINT.

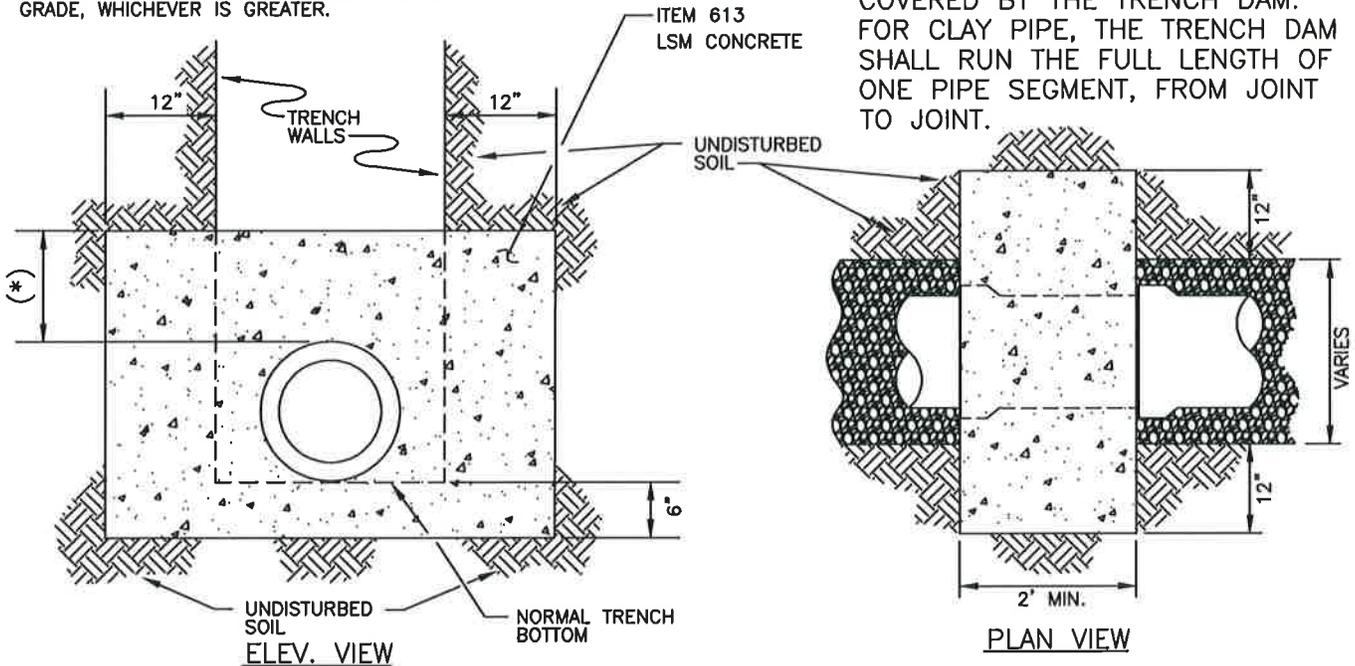

APPROVED 10/10/14
Brad Faquell
 CITY ENGINEER

TRENCH DAM

CITY OF LANCASTER, OHIO
 DEPARTMENT OF ENGINEERING

STANDARD
 CONSTRUCTION DRAWING

REVISED: 10 OCT 14

DWG. BY: SWW
 CHK'D BY: DLC

FILE NUMBER
S-24