

NOTE:

1. ALL METAL TO BE GALVANIZED UNLESS OTHERWISE NOTED.
2. ENCLOSURE MUST MAINTAIN A CLEAR OPENING OF NOT LESS 12 FEET.
3. BLOCK SHOWN FOR REFERENCE ONLY
4. WALL MATERIAL OWNERS PREFERENCE TO BE APPROVED.

APPROVED 7-13-20

SUPERINTENDENT, DIVISION OF SANITATION

Metal

CITY ENGINEER

REVISED: 13 JUL 20


SPECIFICATIONS FOR DUMPSTER ENCLOSURE

CITY OF LANCASTER, OHIO
DEPARTMENT OF ENGINEERING

STANDARD CONSTRUCTION DRAWING

DWG. BY: ADH
CHK'D BY: MN

FILE NUMBER
M-3 SHEET 1 OF 2

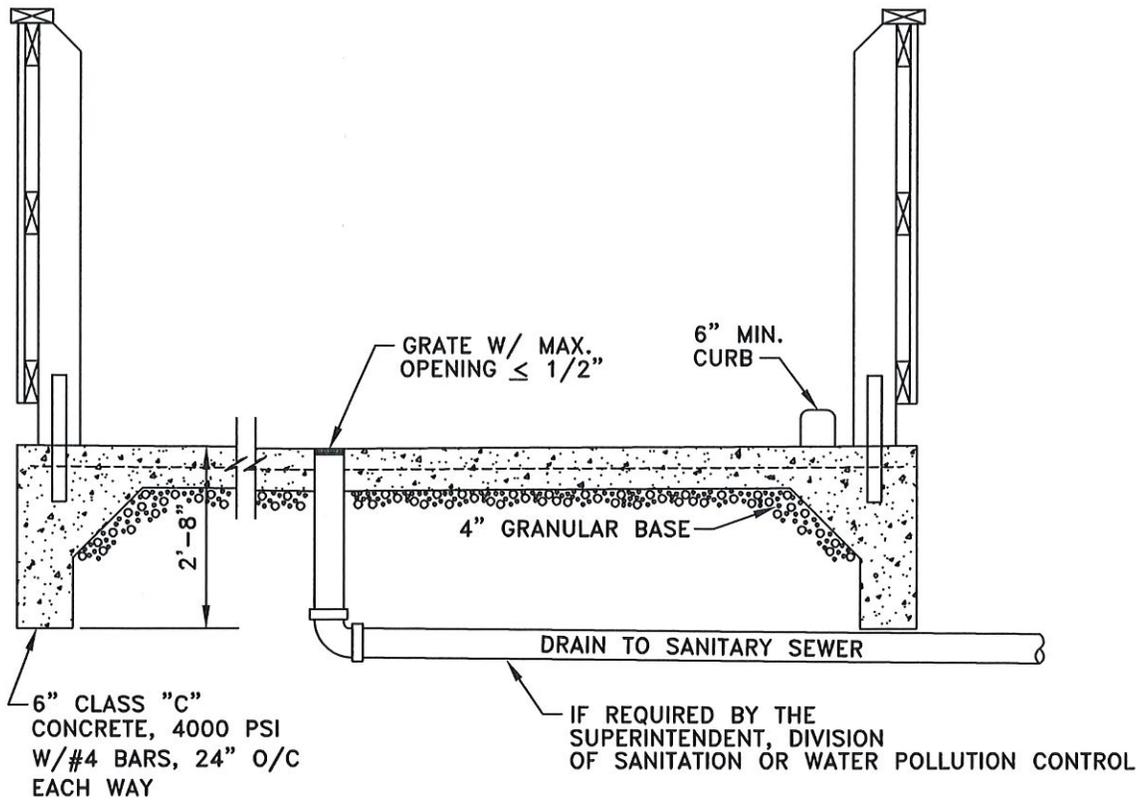

SECTION A-A

1. DOORS SHALL OPEN 180° TO FULL SWING AND SHALL BE SECURABLE IN THE OPEN POSITION. A LATCH SHALL BE INSTALLED ON THE EXTERIOR OF THE DOORS TO SECURE THEM IN THE CLOSED POSITION.
2. CONCRETE IS REQUIRED FOR ENCLOSURE FLOOR AND APPROACH.
3. HEIGHT AND CONSTRUCTION MATERIALS OF WALLS ARE OPTIONAL.
4. WHEN AN ENCLOSURE WITH DOORS IS USED, A PUBLIC GATE NO LESS THAN 36 INCHES WIDE SHALL BE INSTALLED ON THE ENCLOSURE.
5. WATER HOSE CONNECTION SHALL BE AVAILABLE IN OR NEAR THE ENCLOSURE.
6. WHERE WOOD CONSTRUCTION IS USED, INSIDE WALLS SHALL BE PROTECTED BY A RAILING, BOLLARDS, OR CURB TO PREVENT DAMAGE.
7. A DRAIN SHALL BE PLACED IN THE CENTER OF ENCLOSURE WHEN REQUIRED BY THE SUPER-INTENDENT, DIVISION OF SANITATION OR WATER POLLUTION CONTROL. THE DRAIN AND ENCLOSURE PAD SHALL BE CONSTRUCTED SUCH THAT THE DRAIN DOES NOT ACT AS AN AREA DRAIN AND SHALL DRAIN ONLY THE ENCLOSURE PAD. THE PAD SHALL NOT BE LESS THAN 6" HIGHER THAN THE NEARBY GRADES AND THE GROUND SHALL BE SLOPED AT 1/4" PER FOOT AWAY FROM THE PAD. THE PAD SHALL BE AT 1/8" PER FOOT TOWARDS THE DRAIN. THE DRAIN SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND METHODS AS A BUILDING SANITARY SEWER LATERAL. THE DRAIN SHALL HAVE A GREASE TRAP ON A LINE OF APPROVED SIZE WHEN REQUIRED BY THE SUPERINTENDENT, DIVISION OF WATER POLLUTION CONTROL.
8. DUMPSTER DRAINS SHALL BE PLUMBED TO THE OHIO PLUMBING CODE.
9. IT SHALL BE THE PROPERTY OWNERS RESPONSIBILITY TO PROPERLY MAINTAIN THE ENCLOSURE, PAD, DRAINS, GREASE TRAPS, ETC.
10. WHERE NO DRAIN IS INSTALLED, THE DUMPSTER PAD SHALL BE INSTALLED A MINIMUM OF 1.5" ABOVE SURROUNDING PAVEMENT.

APPROVED 7-13-20

SUPERINTENDENT, DIVISION OF SANITATION
Mitch Noland
 CITY ENGINEER

REVISED: 13 JUL 20

SPECIFICATIONS
 FOR
 DUMPSTER ENCLOSURE

CITY OF LANCASTER, OHIO
 DEPARTMENT OF ENGINEERING

STANDARD
 CONSTRUCTION DRAWING

DWG. BY: ADH
 CHK'D BY: MN

FILE NUMBER
 M-3 SHEET
 2 OF 2